



Disconnect from mains supply before replacing the fuse or the lamp.
Vor dem Einsetzen der Sicherung oder der Lampe Spannungsfreiheit herstellen.
Débrancher le secteur avant de remplacer le fusible ou l'ampoule.
Desconectar del suministro de la red, antes de realizar la sustitución del fusible o de la lámpara.
Voor het vervangen van lamp of zekering, eerst netspanning uitschakelen.
Koppla bort spänningen före byte av en säkring eller en lampa.



Switch Off
Abschalten
Débrancher
Desconectar
Uitschakelen
Stäng av

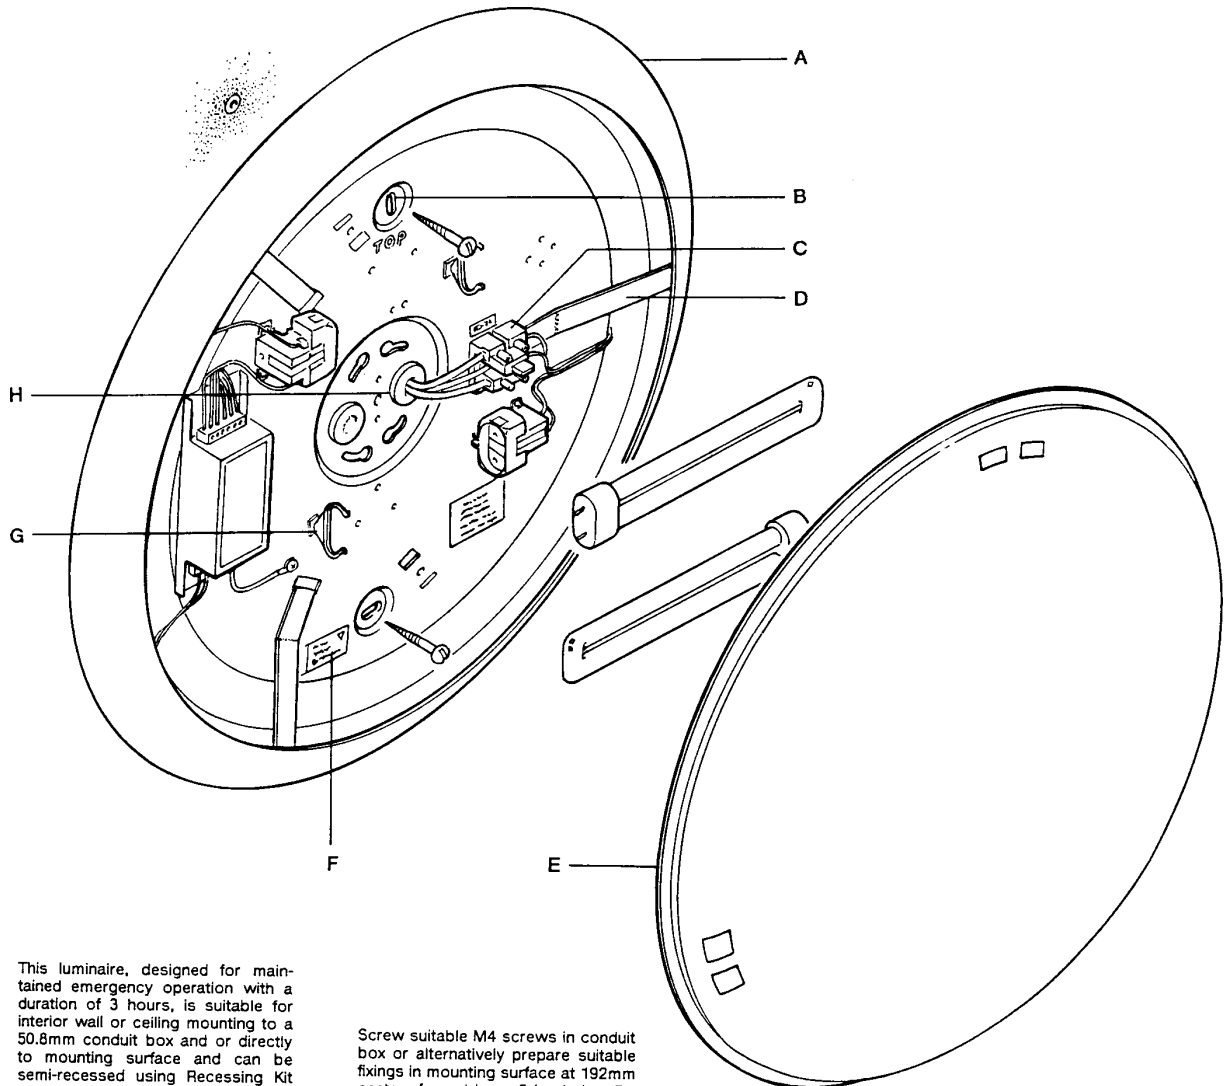

This luminaire, designed for maintained emergency operation with a duration of 3 hours, is suitable for interior wall or ceiling mounting to a 50.8mm conduit box and or directly to mounting surface and can be semi-recessed using Recessing Kit 2045ORX.

Installation should be carried out by a suitably qualified person in accordance with good electrical practice and the appropriate national wiring regulations.

Switch off mains electrical supply before commencing installation.

INSTALLATION PROCEDURE

Remove diffuser (E) from gallery (A) as shown.

Check rating marked on label (F) conforms with mains electrical supply.

Screw suitable M4 screws in conduit box or alternatively prepare suitable fixings in mounting surface at 192mm centres for outrigger fixing holes (B).


Fit supplied grommets (H) in gallery. Pass supply leads through grommet and secure gallery (A) to conduit box or to mounting surface using suitable fixing screws.

NOTE: Gallery is marked TOP for wall mounted applications.


Cover mains supply leads with supplied sleeving and connect leads in respective terminals in terminal block (C).

Fit appropriate lamps as indicated on label (F) in lampholders and support clips (G).


Fit diffuser (E) in gallery as shown, ensuring it is held concentrically by retaining clips (D).



REMOVING DIFFUSER
1. PRESS DOWN 2. PUSH TO SIDE 3. LEVER OUT



FITTING DIFFUSER
1. FLEX IN 2. INSERT UNDER RIM 3. CENTRALISE



Replace any cracked protective shield.

Dieses symbol bedeutet, dass defekte Schutzgläser sofort ersetzt werden müssen.

Ce symbol indique que vous devez remplacer tout verre de protection félé.

Este simbolo indica que hay que reemplazar filtros en caso de rotura o desperfectos.

Dette symbolet indikerer at alle ødelagte (sprukne) sikkerhetglass må skiftes.

Valaisinta el saa käyttää ilman suojalasia vioitunut suojalasi on vaihdettava uuteen ennen valaisimen käyttöön ottoa.

Suitable for use indoors
Geeignet für Innenanwendung
Pour un usage interne
Adecuada para uso en interiores
Geschikt voor gebruik binnen
Lämplig för inomhusbruk



This Electrical Product
MUST be recycled.



< Millimetres >