



2041692 2041693 2041696
2041697
4064674 4064676 4064678
4064680
4065243 4065245 4065247
4065249

Disconnect from mains supply before replacing the fuse or the lamp.
Vor dem Einsetzen der Sicherung oder der Lampe Spannungsfreiheit herstellen.
Débrancher le secteur avant de remplacer le fusible ou l'ampoule.
Desconectar del suministro de la red, antes de realizar la sustitución del fusible o de la lámpara.
Voor het vervangen van lamp of zekering, eerst netspanning uitschakelen.
Koppla bort spänningen före byte av en säkring eller en lampa.



Switch Off
Abschalten
Débrancher
Desconectar
Uitschakelen
Stäng av

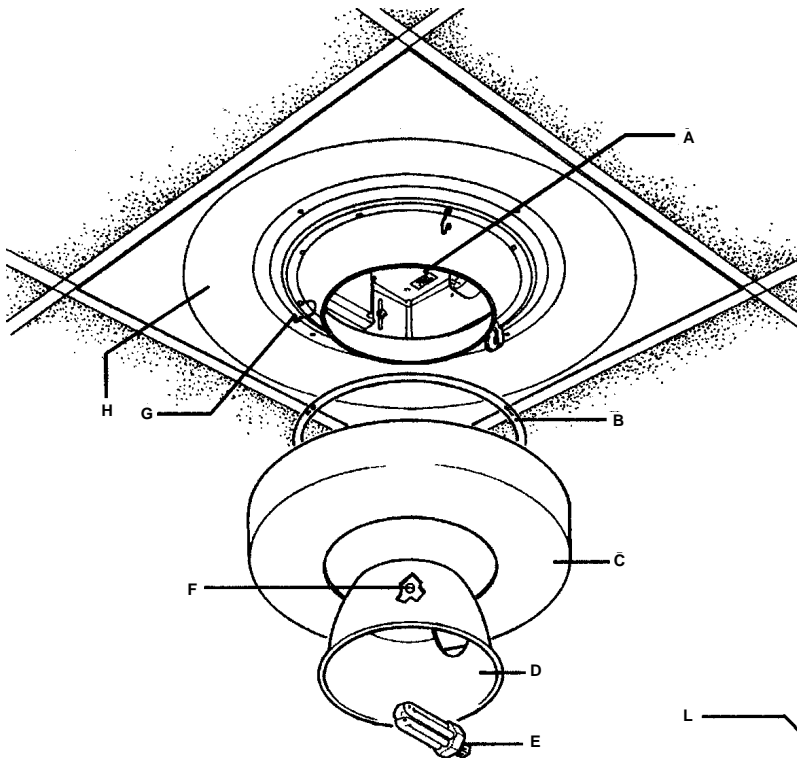

INSTALLATION PROCEEDURE

Wire supplied plug-in connector as shown in Fig. 1.

Unscrew reflector retainer (F) and remove reflector (D) and diffuser (C).

Refer to Fig. 2 - Check dimension and adjust if necessary.

Insert plug-in connector for TC-T lamp (E) in socket (K) and T5 lamp (B) in socket (J).

Locate assembly (H) in position in ceiling grid.

Refer to label (A) and fit appropriate circular lamp (B) into lampholder and retaining clips (G).

Fit diffuser (C) and reflector (D).

Fit appropriate lamp (E) as indicated on the label (A).

NOTE: Total unit weight is:

Kometa 600 = 6.1 Kgs.

Kometa 500 = 4.1 Kgs.

If the ceiling grid is unable to support this weight, we recommend using the Support Cable Assembly, Part No. 4064843 which is fitted into hole (L). Fitting instructions are supplied with the Support Cable Assembly.




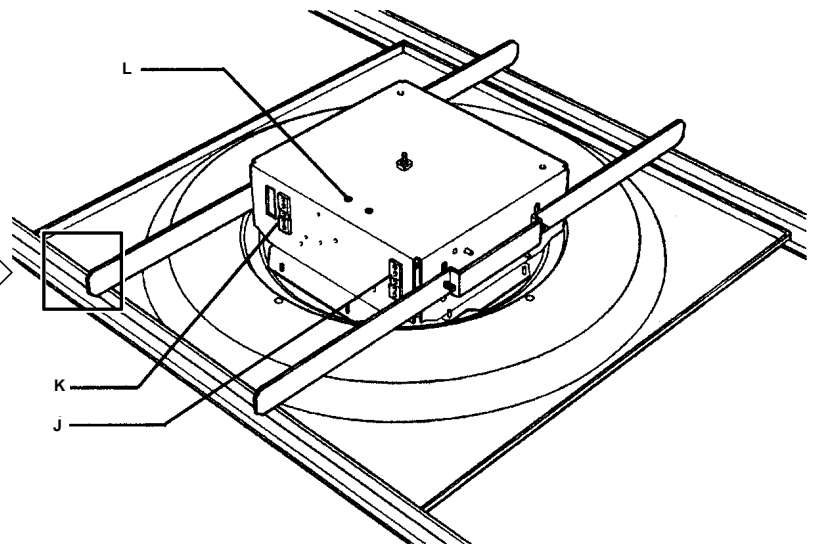


Fig. 1 This luminaire is fitted with two Tridonic eco dimming ballasts, and can be connected to the mains electrical supply for **Switch Dim** or **DSI Dimming**. Connect wiring to an unswitched supply where an on/off control is provided by either the **DSI Dimming** or the **Switch Dim** circuit - see wiring details.
NOTE: The **Switch Dim** control switch **MUST** be momentary action push button, a continuous make toggle switch must **NOT** be used.

Push Button Switch Dim x 2
10 x 1.0mm² Min

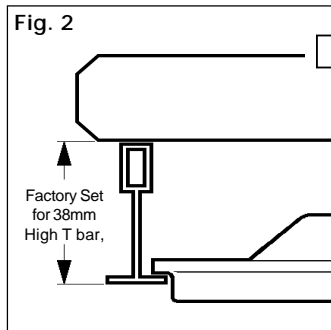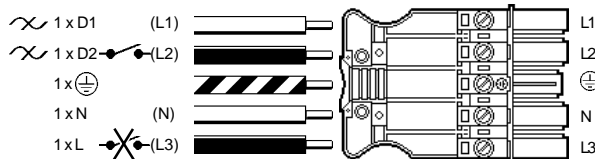

DSI Dim x 2
10 x 1.0mm² Min

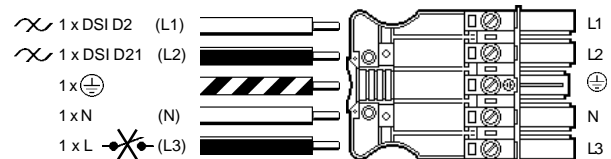

Routine Testing.

Testing should be carried out in accordance with the recommendations of BS 5266.

- 1.) A monthly functional test.
- 2.) Twice yearly, a one hour duration test.
- 3.) Every three years, a full three hour duration test.

(The above tests assume a three hour system.)

- 4.) Batteries shall be replaced when the luminaire no longer meets 3 hours duration performance.
- 5.) Testing could be performed by interrupting the fixed phase supply for the test duration, during which the luminaire should remain lit.

To assist with this testing, a test record chart is supplied below. The test engineer should sign and date each test.

If the charge indicator (LED) is unlit, this signifies a fault. To increase the chance of a fault being reported between monthly tests, it is desirable that occupants are made aware of the purpose of the indicator.

This module should not be modified or repaired by any person other than those nominated by the manufacturer. **ANY** unauthorised modifications may render the module unsafe and will invalidate our warranty and conformance to any safety standards that may apply. The company will accept no responsibility for any modified modules, or for damage caused as a result of any modifications.

All details are given for guidance only and do not constitute a contract. We reserve the right to change the characteristics of products without notice.

Test Record	Type.....	Location.....					
Month Test		1st Year	2nd Year	3rd Year	4th Year	5th year	
	1. Functional						
	2. Functional						
	3. 1Hour						
	4. Functional						
	5. Functional						
	6. Functional						
	7. Functional						
	8. Functional						
	9. 1Hour						
	3 Hour						
	10. Functional						
	11. Functional						
	12. Functional						

Suitable for use indoors

Geeignet für Innenanwendung

Pour un usage interne

Adecuada para uso en interiores

Geschikt voor gebruik binnen

Lämpig för inomhusbruk



Replace any cracked protective shield.

Dieses symbol bedeutet, dass defekte Schutzgläser sofort ersetzt werden müssen.

Ce symbol indique que vous devez remplacer tout verre de protection fêlé.

Este simbolo indica que hay que 'reemplazar filtros en caso de rotura o desperfectos'.

Dette symbolet indikerer at alle ødelagte (sprukne) sikkerhetsglass må skiftes.

Valaisinta el saa käyttää ilman suojalasia vioittunut suojalasi on vaihdettava uuteen ennen valaisimen käyttöön ottoa.

< Millimetres >



This Electrical Product MUST be recycled.



11.07

Concord

Avis Way Newhaven East Sussex BN9 0ED
T 0870 606 2030 F 01273 512 688 email: information@concordmarlin.com

